

ClaytonGO: Foundation Plan Summary

Order Number: **N/A**
 Model Number: **995-4828-5783**
 Home Building Facility: **995**

Home Width: **26 FT 4 IN**
 Home Length: **48 FT 0 IN**
 Outrigger Length (O.R.): **29.24 IN**
 Chassis Spacing: **99.5 IN**

Roof Load: **20 PSF**
 Soil Bearing Cap: **2000 PSF**
 Min. I-Beam Size: **10 IN**
 Calculated Eave/Overhang: **12 IN**

Use this QR Code to access DAPIA approved tables referenced within this design. Hover your iPhone camera over the code. For Android and other devices, download a QR Code reader.
Questions? Email sitecompletionq&a@claytonhomes.com

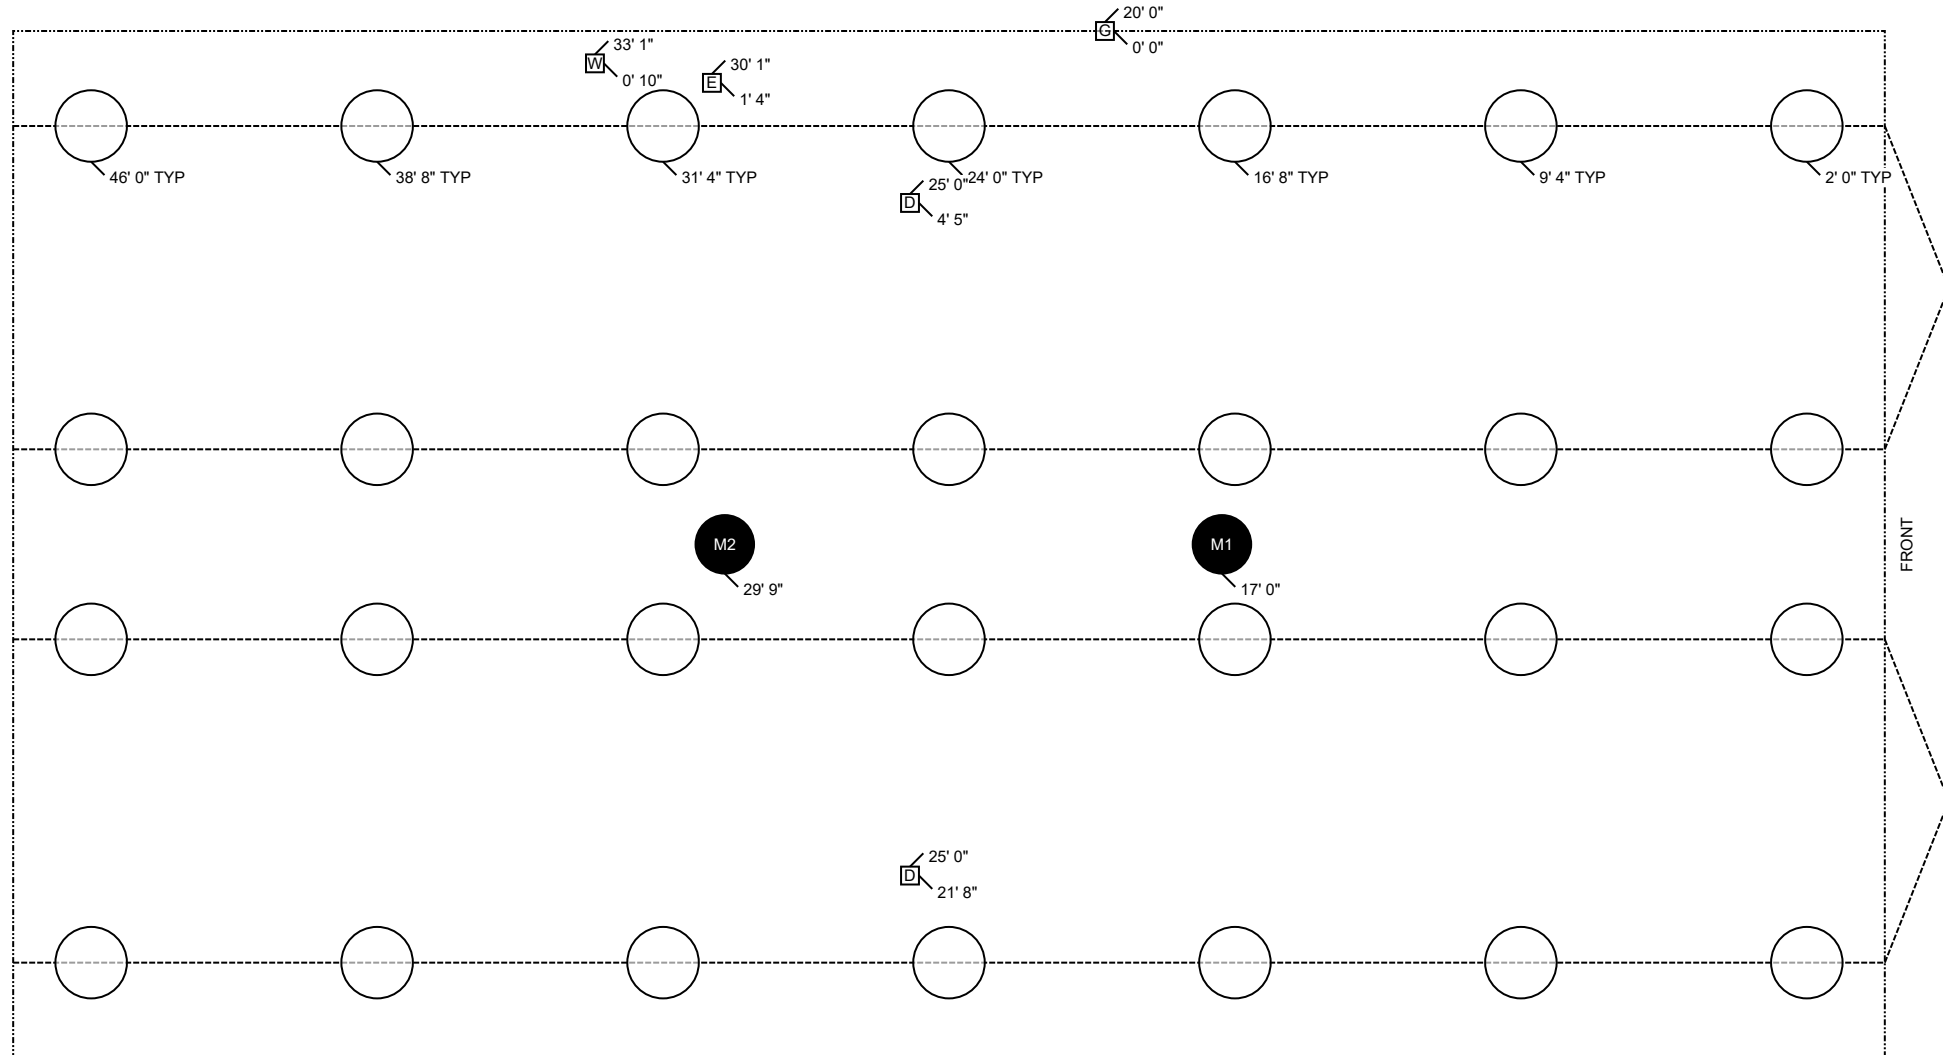


TABLE 1: FRAME PIERS
 Pier Spacing
 TYP. 7 FT 4 IN
 MAX. 8 FT 0 IN
 (Table 7)

Pier Configuration	Footer Size
Single stacked	22 IN Diameter x 7 IN
Single stacked	24 IN Diameter x 8 IN

TABLE 3: MARRIAGE WALL PIERS
 Pier ID
 M1, M2
 (Table 6)

Pier Configuration	Footer Size
Single stacked	18 IN Diameter x 6 IN



ClaytonGO: Foundation Plan Summary

Order Number: **N/A**
Model Number: **995-4828-5783**
Home Building Facility: **995**

Home Width: **26 FT 4 IN**
Home Length: **48 FT 0 IN**
Outrigger Length (O.R.): **29.24 IN**
Chassis Spacing: **99.5 IN**

Roof Load: **20 PSF**
Soil Bearing Cap: **2000 PSF**
Min. I-Beam Size: **10 IN**
Calculated Eave/Overhang: **12 IN**

Use this QR Code to access DAPIA approved tables referenced within this design. Hover your iPhone camera over the code. For Android and other devices, download a QR Code reader. **Questions? Email sitecompletionq&a@claytonhomes.com**



UTILITIES		LOCATION	
ID	UTILITY	LEFT	DOWN
D	Drain Drop	25 FT 0 IN	21 FT 8 IN
D	Drain Drop	25 FT 0 IN	4 FT 5 IN
E	Elec Entrance	30 FT 1 IN	1 FT 4 IN
G	Gas Inlet	20 FT 0 IN	0 FT 0 IN
W	Water Inlet	33 FT 1 IN	0 FT 10 IN

NOTES:

1. FROST PROTECTION WILL BE PROVIDED BY PLACING FOOTERS BELOW FROST DEPTH OF 35 INCHES PER (FIGURE 5A) OR FROM LAHJ. Frost depth for interior footers may be taken as half with R5 skirting per (Table 5) [3285.312(b)]
2. HOME HAS BEEN BUILT WITH ADDITIONAL FLOOR JOIST AT SIDEWALL OPENINGS TO ELIMINATE NEED OF SIDEWALL PIERS. SIDEWALL PIERS SHALL BE PLACED WHERE INDICATED BY PIER TAGS ON HOME.
3. ALL FOOTERS WILL BE POURED CONCRETE. ALL SINGLE STACKED PIERS WILL HAVE A MINIMUM FOOTER THICKNESS OF 8 INCHES with footer depth extending below frost depth using 3,000 PSI minimum concrete (table 12) (table 10)
4. THIS PIER LAYOUT HAS BEEN DERIVED USING PE SEALED & DAPIA APPROVED INSTALLATION MANUAL AS OUTLINED ABOVE. PLEASE SEE INSTALLATION MANUAL FOR PE SEAL AND DAPIA APPROVAL. (Reference to Clayton Homes DAPIA approved Installation manual) [Reference to Federal Statutes 24 CFR Part 3280, 3285 or 3286]

